

SEWER CONNECTION APPLICATION

Property Owner: _____

Property Address: _____

I certify that I will conform to all Ordinances and notify the City of Le Roy for all inspections pertaining to the following work. I agree that all work is to be done at my expense under the supervision of the City of Le Roy.

I understand that the City of Le Roy and the IEPA regulations prohibit sump pump (inspected at the time of installation), down spouts, foundation drains, and any other surface or ground water collectors to be connected to the sanitary sewer system.

I hereby certify that the proposed work is authorized by the owner of record and that I have been authorized by the owner to make this application as his authorized agent and I agree to conform to all applicable laws of this jurisdiction.

Applicant: (Signed) _____


(Addressed) _____

(Dated) _____

- | | | |
|-----------------|------------|----------------------|
| ○ Residential | \$500.00 | Sewer Connection Fee |
| | \$ 50.00 | Inspection Fee |
| ○ Commercial | \$1,000.00 | Sewer Connection Fee |
| | \$ 50.00 | Inspection Fee |
| ○ Industrial | \$2,500.00 | Sewer Connection Fee |
| | \$ 50.00 | Inspection Fee |
| ○ Institutional | \$300.00 | Sewer Connection Fee |
| | \$ 20.00 | Inspection Fee |

Sewer Connection Inspection: _____
Inspector

_____ Date

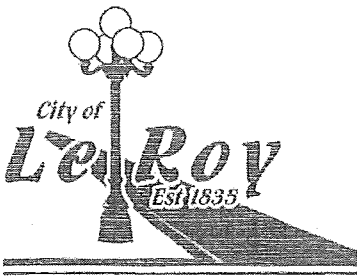

City of Le Roy Sewer Connection Requirements

1. Piping: 4"-6" approved pipe: PVC Sch 40 w/bell, SDR-26 G.J., Sch-35 G.J. (may use solvent weld fittings w/primer and glue)
2. Fall no less than 1/8" and no more than 1/4" per foot.
3. Clean-out shall be the same size as host pipe, and no further than 5 feet from building.
4. No elbows greater than 45 degrees shall use 2- 45 degree fittings with spacer pipe to make 90 degree turns (outside of building only).
5. May use rubber transition fittings w/ stainless steel clamps at connection.
6. No sump pumps, down spouts, or other clear water sources hooked to sewer service line.
7. Septic tank pumped prior to by-passing, receipt required, septic outlets shall be plugged, shall be back filled with 3/8" pea-gravel or other APPROVED MATERIAL by City of Le Roy.
8. Bedding: pipe shall have 2"- 3" of pea-gravel below pipe, and 8"-12" of pea-gravel above pipe prior to backfilling. May use other material with prior APPROVAL by City of Le Roy (even in grassy areas and out of City of Le Roy right-of-way.)
9. Shall obtain City of Le Roy permits prior to digging (unless emergency.)
10. Street back-fill: 3/8" pea-gravel to within 8"-12" of surface, then shall use CA-6. May use other (APPROVED by City of Le Roy) materials, shall be compacted in 12" lifts, this shall be done in all areas that are paved or are an entrance.
11. May be required to use FLOWABLE FILL on primary traffic routes or other heavily used routes.
12. SHALL NOT TIE INTO ANY MANHOLE UNLESS PRIOR APPROVAL BY CITY OF LEROY
13. Shall be inspected by City of Le Roy representative prior to back-filling.

Contacts: Scott Bryant, Wastewater Supt. 1-309-275-3573

Sewer Dept: 1-309-962-3211

City Hall: 1-309-962-3031

*** No statement contained in this article shall be construed to interfere with any additional requirements that may be imposed by the City of Le Roy